

Middletown Township Requirments for Fire Lanes

Standard 86-1

Minimum fire lane width and height

Fire Lanes are required to be a minimum of 20 feet or greater and an unobstructed vertical clearance of not less than 13 feet 6 inches (4115 mm).

Fire lanes width of 26 feet or less.

Fire lanes 20 to 26 feet wide (6096 to 7925 mm) shall be posted on both sides as a fire lane with the appropriate signage.


Fire lanes more than 26 feet in width.

Fire lanes more than 26 feet wide (7925 mm) to 32 feet wide (9754 mm) shall be posted on one side of the road as a fire lane.

Paint

Color—Traffic Yellow

Type of Paint—High visibility
(con-lux or equivalent)

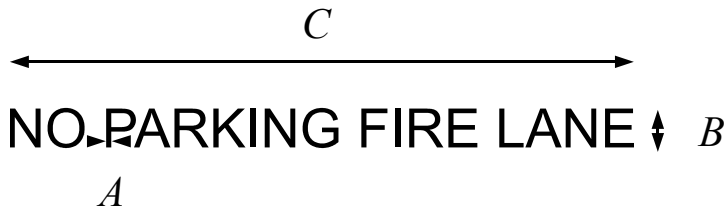

A - Minimum width of any part of a letter is four (4) inches.

B - Minimum height of letters is thirty six (36) inches

C - Minimum length of message is fifty (50) feet

Signage for Fire Lanes

The fire lane shall be marked with permanent NO PARKING—FIRE LANE signs. Signs shall have a minimum dimension of 12 inches (305 mm) wide by 18 inches (457 mm) high and have red letters on a white reflective background. Signs shall be posted on one or both sides of the fire apparatus road as required above.


SIGN TYPE "A"



SIGN TYPE "C"



SIGN TYPE "D"



Signs are to be a maximum of 50 feet apart and in clear view.

Fire lanes shall be provided for every facility, building or portion of a building hereafter constructed or moved into or within the jurisdiction.